

(1) CERTIFICATE

(2) No. of the Certificate: **ZP/B131/16-PZ replaced ZP/B130/15-PZ**

(3) Product: **Anchor device type A
Type: ABS-Lock® X-HD**

(4) Manufacturer: **ABS Safety GmbH**

(5) Address: **Gewerbering 3, 47623 Kevelaer**

(6) The design of this product and any acceptable variation thereto are specified in the appendix to this certificate.

(7) The Certification Body of DEKRA EXAM GmbH certifies that this product comply with the requirements of the test regulations listed under item 8 below. The test results are recorded in test report PB 16-227.

(8) The requirements are assured by compliance with

DIN EN 795:2012

DIN CEN/TS 16415:2013

(9) This certificate relates only to the design and tests of the specified product in accordance to the contemplated requirements. Further requirements applied to the manufacturing process and supply of this product, are not covered by this certificate.

(10) The manufacturer is authorised to apply the mark of conformity to the products that conform to the types examined.

(11) This certificate is valid until 25.09.2021.

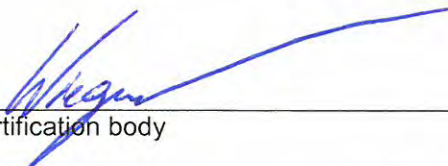



DEKRA EXAM GmbH
Bochum, 26-09-2016

Signed: Wiegand
Certification Body

Signed: Mühlenbruch
Special services unit

We confirm the correctness of the translation from the German original. In the case of arbitration only the German wording shall be valid and binding.


Certification body


Special services unit

(12) Appendix to

(13) **Certificate**
ZP/B131/16-PZ

(14) 14.1 Subject and type
Anchor device type A
Type: ABS-Lock® X-HD

14.2 Description

The anchor device of type ABS-Lock® X-HD (Fig. 1) is a single anchor point that is used to protect a maximum number of three persons against falls from a height. It is mounted on concrete substrates with sufficient strength. The anchor device is fastened by drillings (Ø 12 mm) in the base plate and appropriate fastening elements in the form of hollow core dowels (M10).

The support (Ø 16 mm) that is centrally welded onto the base plate is between 300 mm and 800 mm long. The lower end of the support is surrounded by a sleeve.

The dimensions of the base plate are 220 mm x 220 mm x 5 mm. At the top end of the support there is a ring-shaped eyelet securely screw-fastened. The users can protect themselves against falls from a height by connecting their personal protective equipment to the eyelet.

The anchor device is made of corrosion-resistant steel and is intended for load from any direction parallel to the building surface.

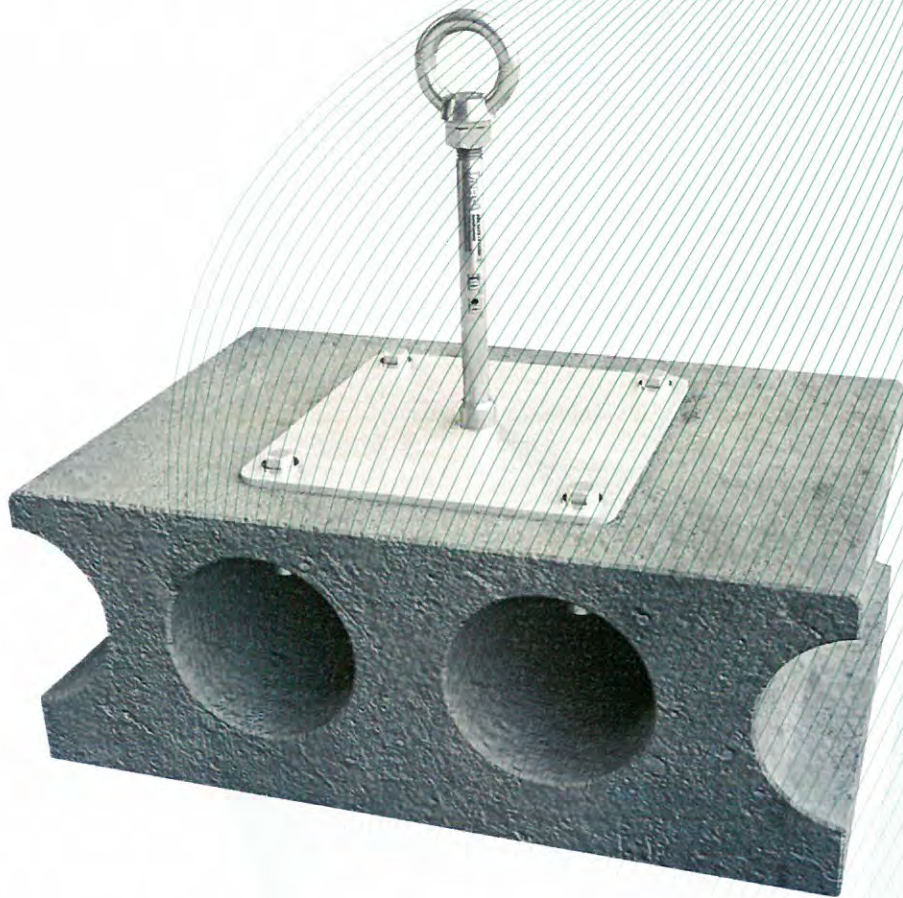


Fig. 1: Anchor device, type: ABS-Lock® X-HD

(15) Test Report

PB 16-227, 23-09-2016